

Puraflo[®]

Peat Fiber Biofilter


Type B Drain Piping Manual



Only modules bearing the NSF[®] logo and designated P150N*XX are certified to NSF/ANSI Standard 40




NOTE: Not to scale

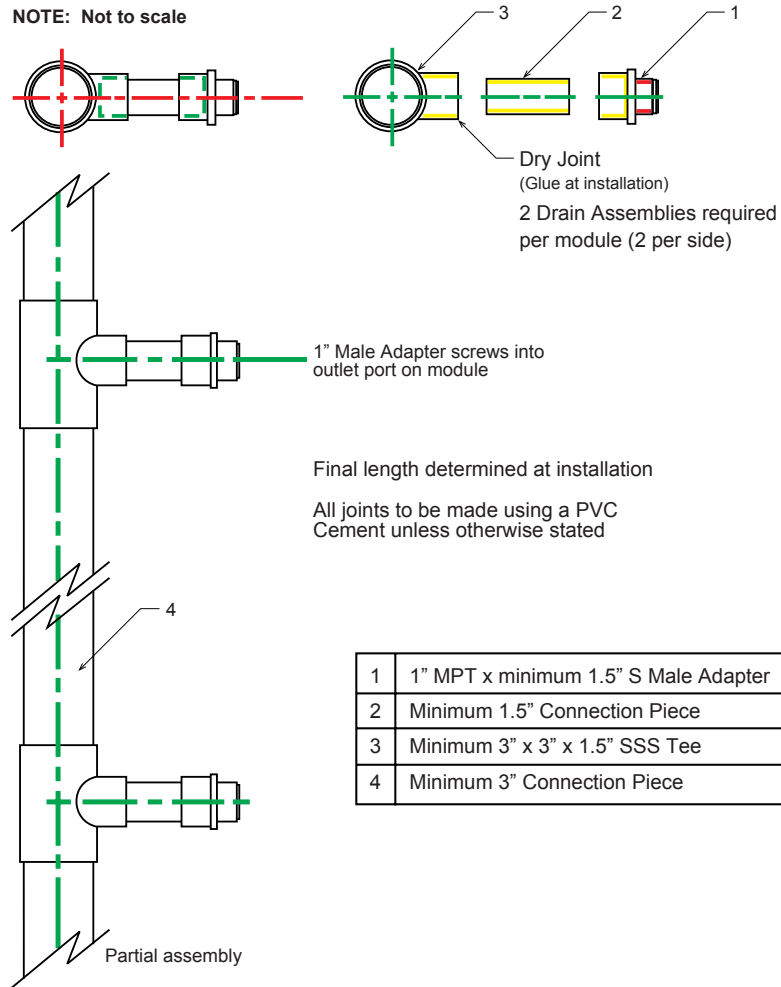


NOTES:

1. All piping and fittings <3 inch diameter must be a minimum schedule 40 rated.
2. Minimum pipe size diameter from module to main line is 1.5 inches.
3. Minimum main line diameter to sample chamber is 3 inches.

NOTE: Not to scale

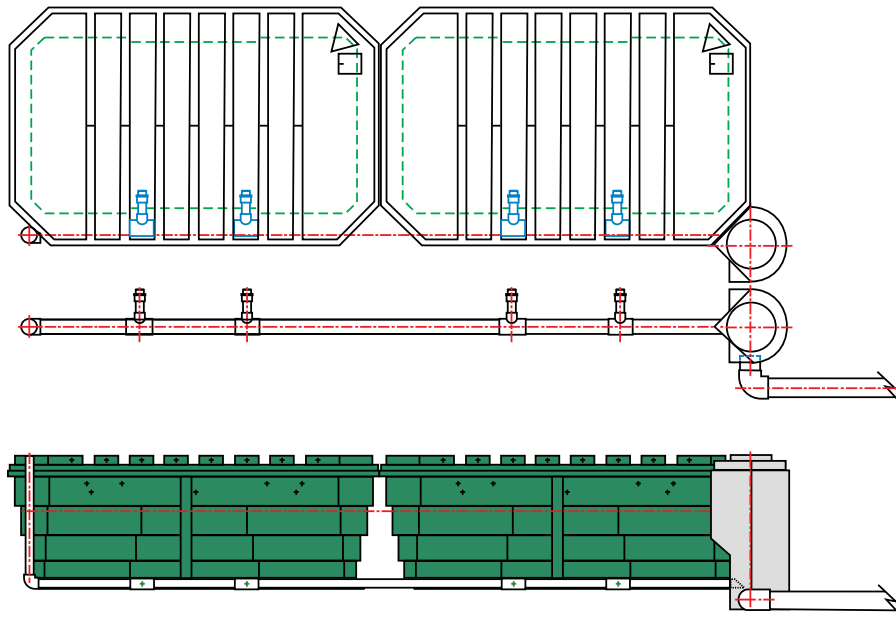

NOTE:
Threaded inserts not used for drainage (opposite those in use). Must be plugged.

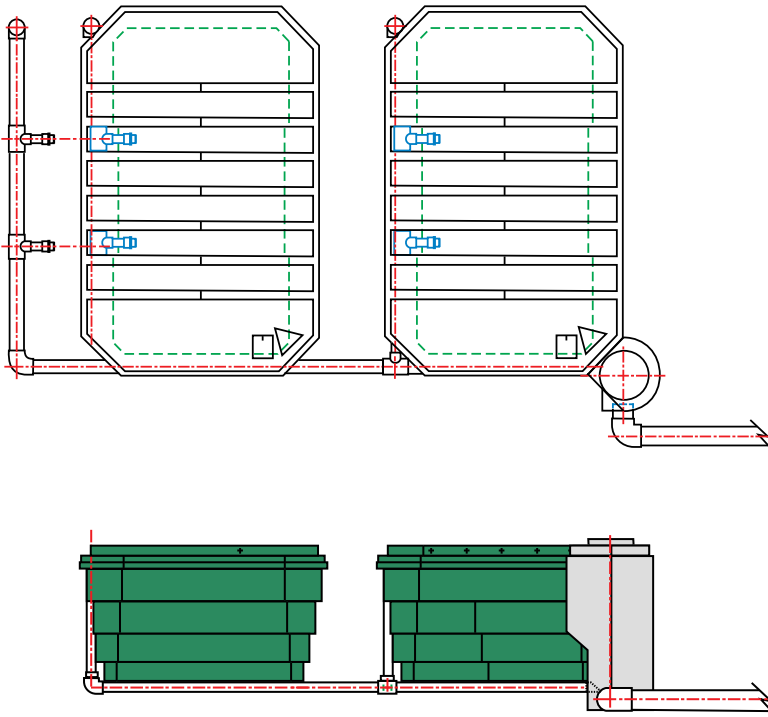



P.O. Box 77457
Greensboro, NC 27417

T 336.547.9338
F 336.547.8559
anuainternational.com



DISTRIBUTED BY:
MWM
570-924-4696
WWW.MountainWastewater.com